


1. All clearances and protective devices to be in conformance to the most stringent requirements of either the NESC, NEC or other codes of governmental or regulating authorities as applicable.
2. If length of conduit exceeds 10 feet, coupling is permitted on end adjacent to meter.
3. Guy pole as required.
4. For every additional 5' length on meter loop add 20' of wire to the installation.

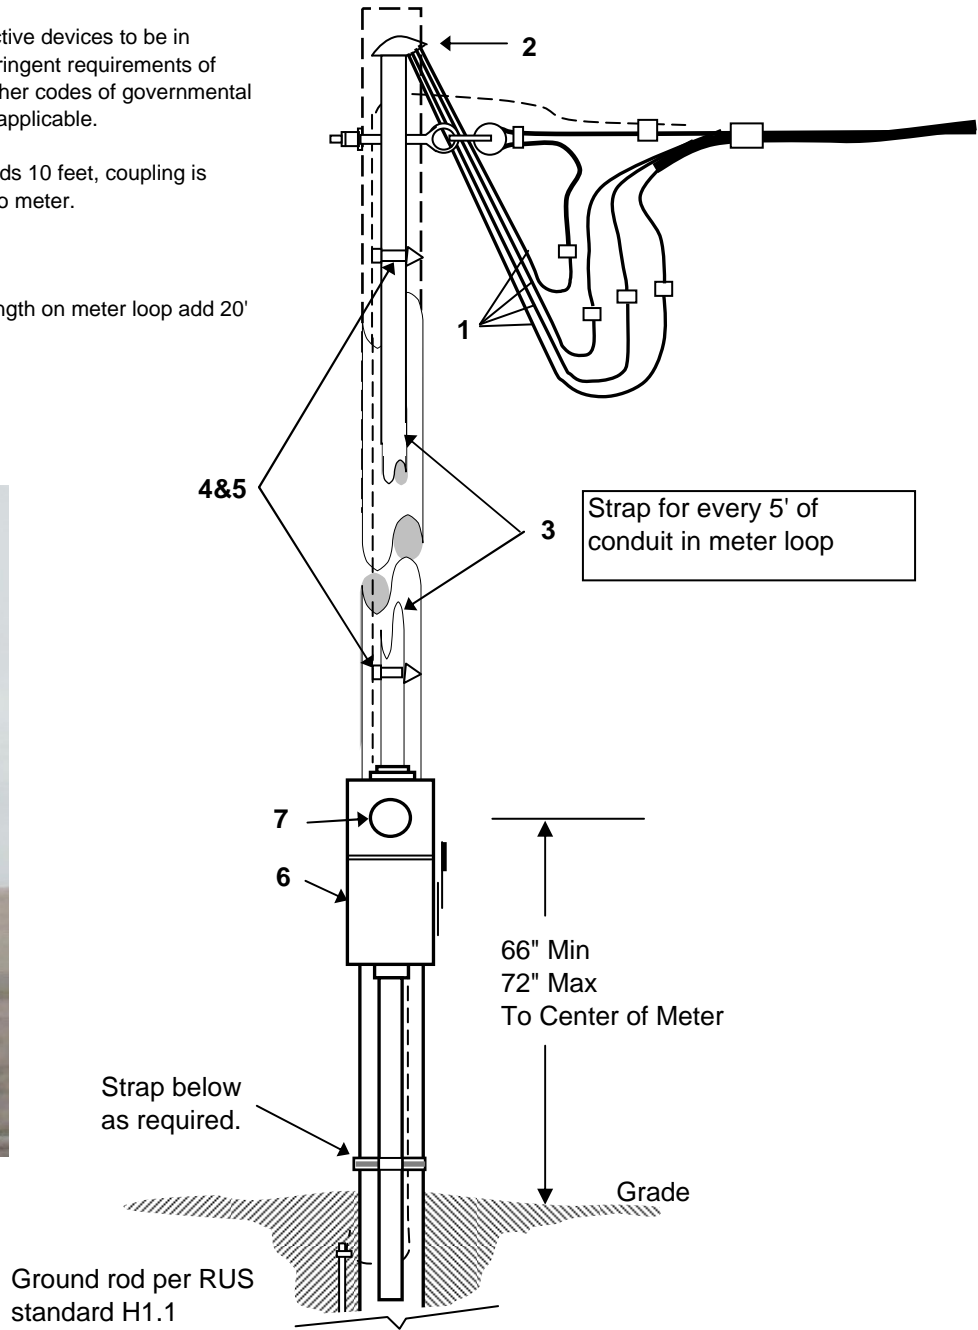

MATERIALS LISTING

ITEM	DESCRIPTION	UNIT	PREC #
1	200A Three-Phase Meter Loop	Ea.	8312-*
6	7T 200A 3 Phase Meter Box w/Disconnect	Ea.	9186
7	Form 16S/15S Class 200 120-480V 4-Wire 3 Ø Meter	Ea.	

Design Parameters:
 > See design notes 1 through 4 above.
 > *Loop length per staking sheet.

**277/480V 200A - 15, 25, & 50kVA Transformers (150 kVA Bank)
 4-Wire Self Contained, 15' & 20' Down Loop Mounted on Meter Pole
 (Self Contained)**

6/3/2008 Rev. 0		Q3.4-02SC*
--------------------	--	------------